



THE PORT AUTHORITY
OF NY & NJ


CONFORMED DRAWING
08/19/98
SIGNED AND SEALED
COPY IS KEPT ON FILE

ORIGINAL SIGNED & SEALED BY
NY P.E. (OR R.A.)

Joseph R. Loring
& Associates, Inc.
consulting engineers
One Pennsylvania Plaza
New York, New York 10119-0045
Tel (212) 512-7400, Fax (212) 512-7382

IN CHARGE OF
DAVID
ELLIOT
LEBOVITZ
P.E.
REGISTERED PROFESSIONAL ENGINEER
IN THE STATE OF NEW YORK BY 0006
16 JULY 1998 FAX (212) 512-7382


LESLIE E ROBERTSON
ASSOCIATES, R.L.P.
CONSULTING ENGINEERS
20 EAST 40TH STREET
NEW YORK, NY 10018-3608
TEL (212) 697-8800 FAX (212) 697-8800

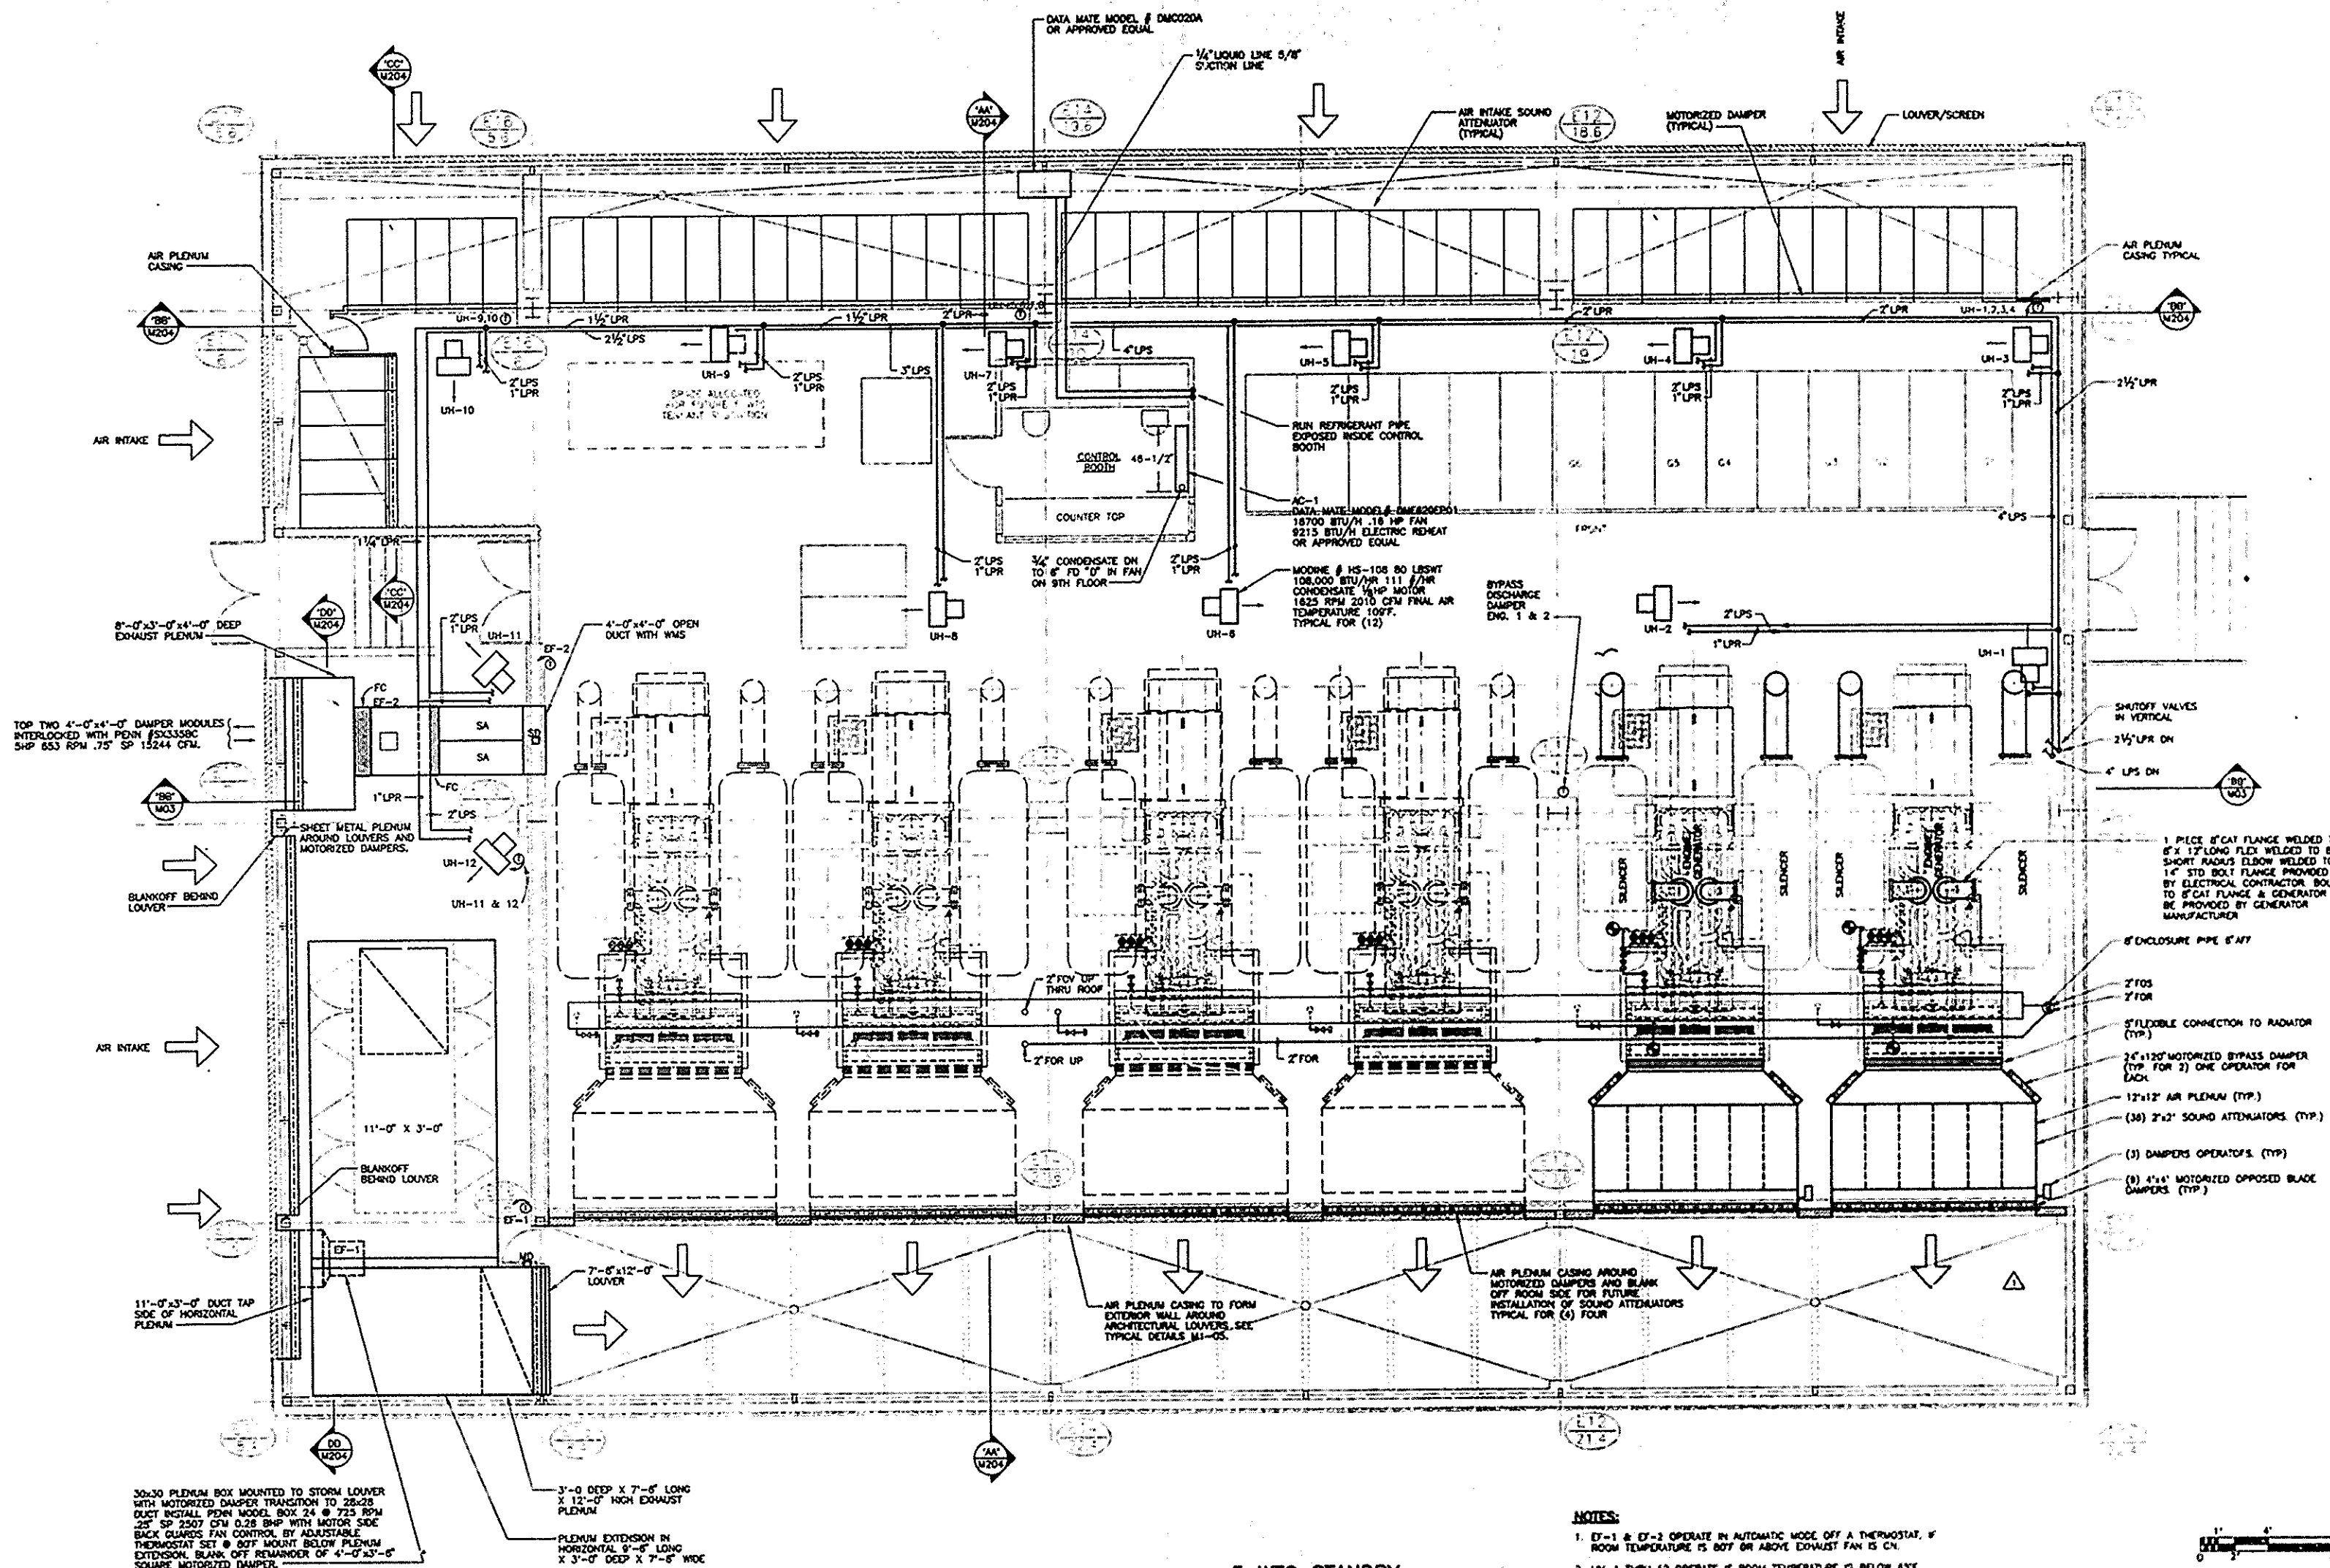

5 WTC STANDBY
GENERATOR ROOM HVAC PLAN

NOTES:

1. EF-1 & EF-2 OPERATE IN AUTOMATIC MODE OFF A THERMOSTAT. IF ROOM TEMPERATURE IS 60°F OR ABOVE EXHAUST FAN IS ON.
2. UN-1 THRU 12 OPERATE IF ROOM TEMPERATURE IS BELOW 65°F.
3. AC-1 TO OPERATE OFF INTERNAL THERMOSTAT.
4. SPLITTER FURNISHED BY ELECTRICAL. INSTALLED UNDER MECHANICAL WORK.

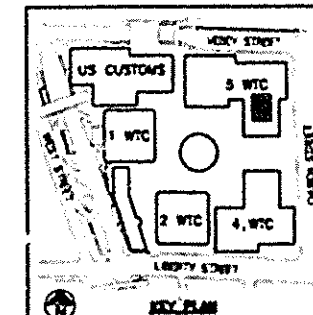

Engineering Department
Design Division

The
World
Trade
Center

STANDBY POWER
5 WORLD TRADE CENTER

MECHANICAL

5 WTC STANDBY
GENERATOR BULKHEAD
HVAC PLAN

This drawing is subject to conditions in contract documents. Design and construction are reserved to Port Authority and may not be used without its written consent.

20 M.A.R.
Designed by: [Signature] Drawn by: [Signature] Check by: [Signature]
Date: 11/11/98 Scale: AS NOTED
Contract Number: WTC-946.071 Drawing Number: M2-03